


A

THIS DETAIL A IS FOR RESIDENTIAL WATER SERVICES WHERE A CONTINUOUS ROLL OF COPPER FROM CURB-BOX TO INSIDE WALL OF THE HOUSE OR STRUCTURE CAN BE INSTALLED. ABSOLUTELY NO FITTINGS / SPLICES ARE ALLOWED. A METER PIT WILL BE NECESSARY IF THE SERVICE REQUIRES MORE THAN ONE CONTINUOUS ROLL OF COPPER.

NOTES:

1. METER REQUIRES STRAIGHT PIPE LENGTHS A MINIMUM OF 5 PIPE DIAMETERS IMMEDIATELY UPSTREAM OF THE METER AND A MINIMUM OF 2 PIPE DIAMETERS AFTER THE METER AND BEFORE ANY OTHER APPURTENANCES.
2. ANY MODIFICATION MUST BE APPROVED BY THE EWW ENGINEERING DEPARTMENT IN ADVANCE.
3. NOTIFY EWW 2 DAYS PRIOR TO INSTALLING / BACKFILLING SERVICE LINE FOR INSPECTION.
4. THE WATER WILL NOT BE TURNED ON UNTIL THESE ERIE WATER WORKS SERVICE SPECIFICATIONS ARE COMPLIED WITH.
5. THERMAL EXPANSION SHOULD BE ADDRESSED BY CUSTOMERS PLUMBER.

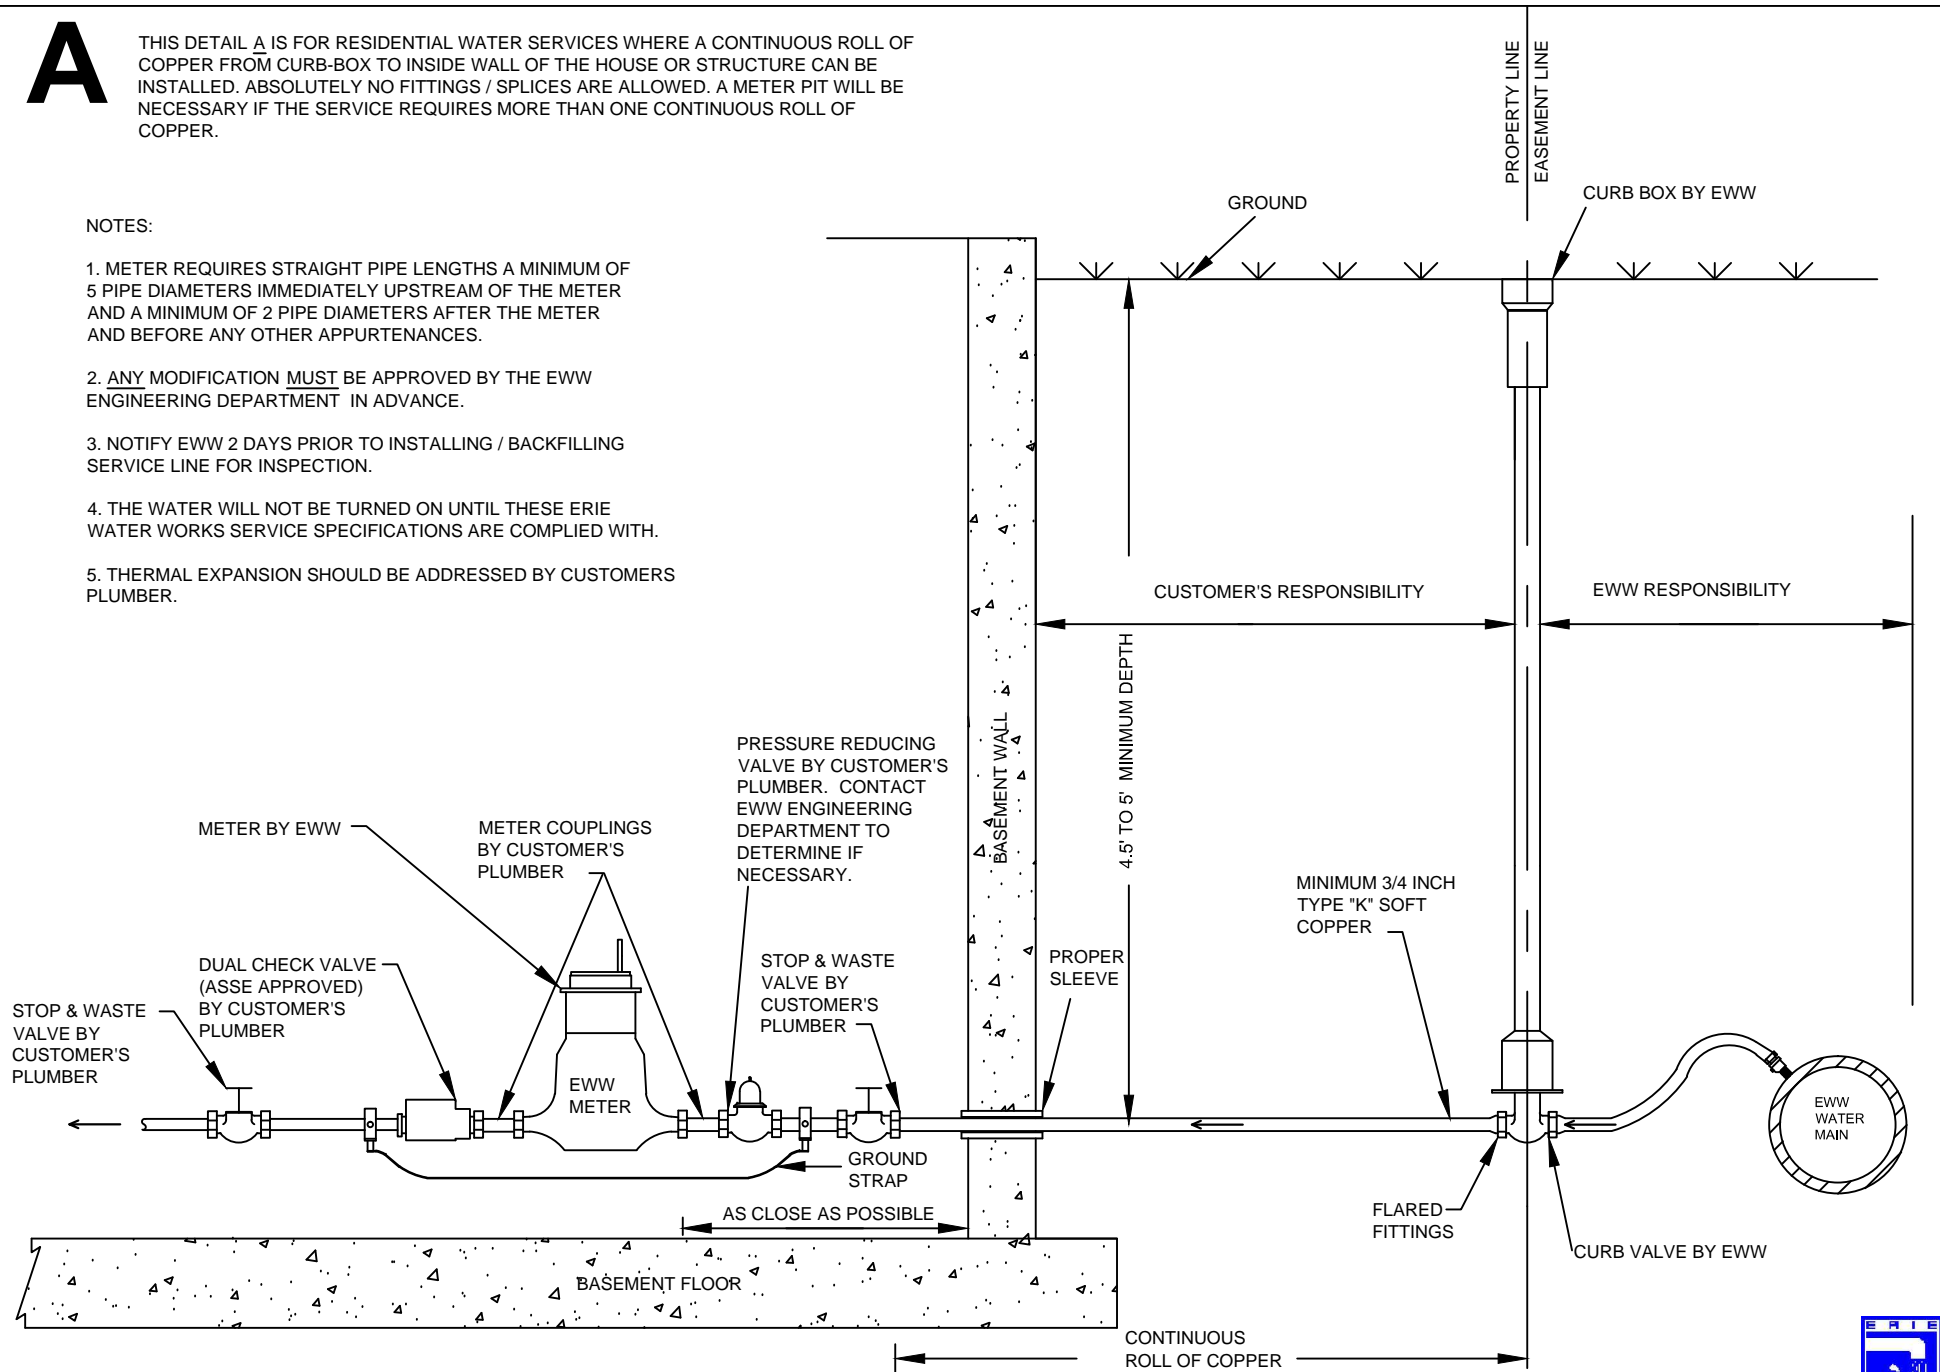

DRAWN BY: PH APPROVED BY: CP
DATE: OCT 2010 NOT TO SCALE

RESIDENTIAL SERVICE (CONTINUOUS ROLL OF COPPER)

ERIE WATER WORKS
240 West 12th Street
Erie, PA 16501

