


B.1

THIS DETAIL B IS FOR 1.5" AND 2" RESIDENTIAL WATER SERVICES WHERE A CONTINUOUS ROLL COPPER FROM CURB-BOX TO INSIDE WALL OF HOUSE OR STRUCTURE COULD NOT BE INSTALLED.

NOTES:

1. ALL PRECAUTIONS SHOULD BE TAKEN FOR PROPER DRAINAGE.
2. ANY MODIFICATIONS MUST BE APPROVED BY THE EWW ENGINEERING DEPARTMENT IN ADVANCE.
3. NOTIFY EWW 2 DAYS PRIOR TO INSTALLING / BACKFILLING FOR SERVICE LINE AND METER PIT INSPECTION.
4. IF A PRESSURE REDUCING VALVE IS REQUIRED, INSTALLING IT IN THE LOCATION SHOWN MAY MAKE IT DIFFICULT TO ADJUST IN THE FUTURE. CONTACT THE EWW ENGINEERING DEPARTMENT TO DISCUSS POSSIBLE ALTERNATIVES IF DESIRED.
5. THERMAL EXPANSION SHOULD BE ADDRESSED BY CUSTOMERS PLUMBER.
6. THE WATER WILL NOT BE TURNED ON UNTIL THESE ERIE WATER WORKS SERVICE SPECIFICATIONS ARE COMPLIED WITH.

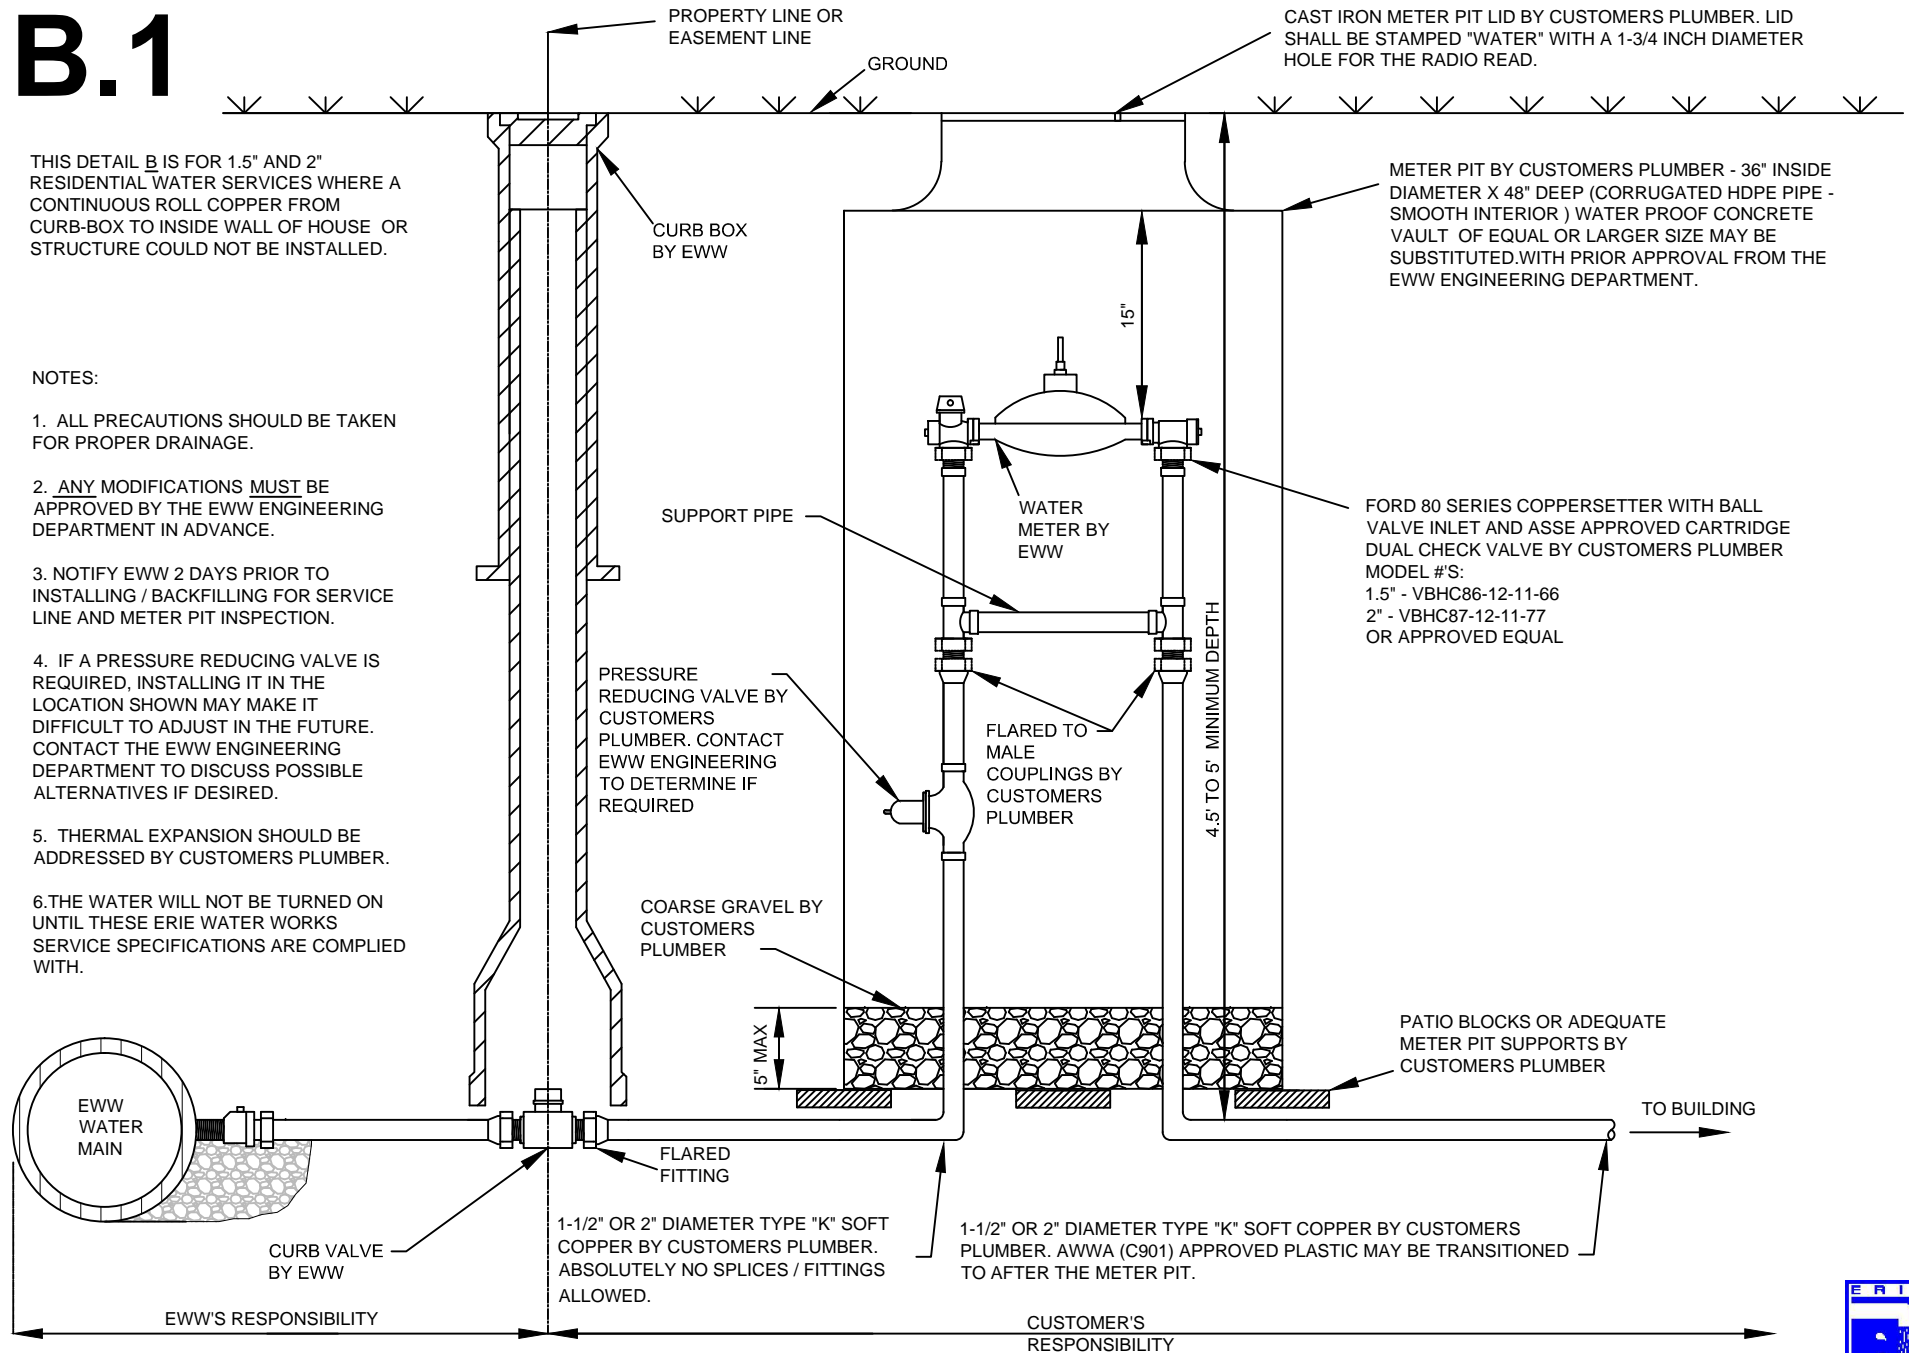

DRAWN BY: PH
 APPROVED BY: CP
 DATE: OCT 2010
 NOT TO SCALE

RESIDENTIAL SERVICE (1.5" AND 2" METER PIT)

ERIE WATER WORKS
 240 West 12th Street
 Erie, PA 16501

