

PLEASE COMPLETE AND RETURN TO ERIE WATER WORKS ENGINEERING DEPARTMENT
 240 WEST 12TH STREET, ERIE, PA 16501
 PH: (814) 870-8000 EXT 205, FAX: (814) 870-8011

BACKFLOW PREVENTER (BFP): _____

TYPE: (circle) RP or DC _____

MAKE: _____

MODEL: _____

SIZE: _____

BUSINESS NAME: _____


SERVICE ADDRESS: _____

TYPE OF BUSINESS: _____

C THIS DETAIL C IS FOR RESIDENTIAL WATER SERVICES WHERE BACKFLOW PREVENTION IS REQUIRED AND A CONTINUOUS ROLL OF COPPER FROM CURB-BOX TO INSIDE WALL OF THE HOUSE OR STRUCTURE CAN BE INSTALLED. ABSOLUTELY NO FITTINGS / SPLICES ARE ALLOWED. A HOT-BOX OR EQUIVALENT WILL BE NECESSARY IF THE SERVICE REQUIRES MORE THAN ONE CONTINUOUS ROLL OF COPPER.

NOTES:

1. METER REQUIRES STRAIGHT PIPE LENGTHS A MINIMUM OF 5 PIPE DIAMETERS IMMEDIATELY UPSTREAM OF THE METER AND A MINIMUM OF 2 PIPE DIAMETERS AFTER THE METER AND BEFORE ANY OTHER APPURTENANCES.
2. ANY MODIFICATION MUST BE APPROVED BY THE EWW ENGINEERING DEPARTMENT IN ADVANCE.
3. NOTIFY EWW 2 DAYS PRIOR TO INSTALLING / BACKFILLING SERVICE LINE AND BACKFLOW ASSEMBLY FOR INSPECTION.
4. THE WATER WILL NOT BE TURNED ON UNTIL THESE ERIE WATER WORKS SERVICE SPECIFICATIONS ARE COMPLIED WITH.
5. THERMAL EXPANSION SHOULD BE ADDRESSED BY CUSTOMERS PLUMBER.

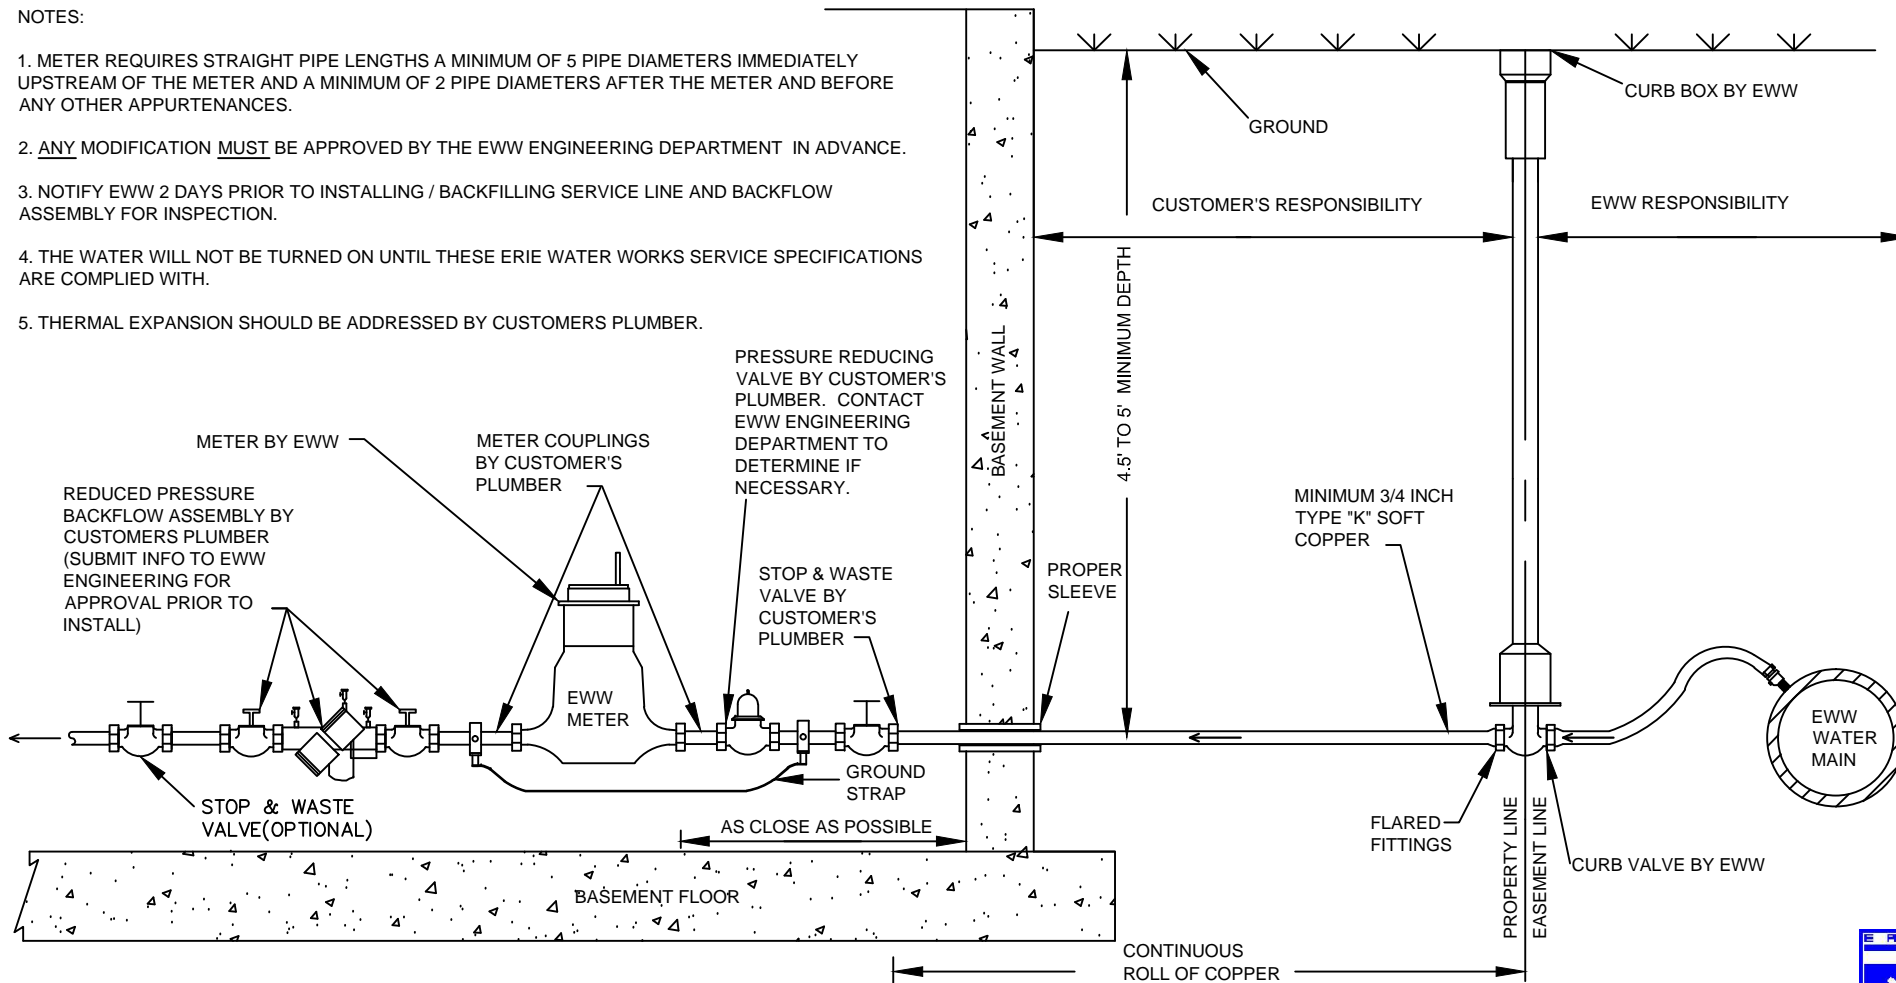

DRAWN BY: PH	APPROVED BY: CP
DATE: OCT 2010	NOT TO SCALE

RESIDENTIAL SERVICE (CONTINUOUS ROLL OF COPPER) BFP

ERIE WATER WORKS
 240 West 12th Street
 Erie, PA 16501

