

PLEASE COMPLETE AND RETURN TO ERIE WATER WORKS ENGINEERING DEPARTMENT  
 240 WEST 12TH STREET, ERIE, PA 16501  
 PH: (814) 870-8000 EXT 205, FAX: (814) 870-8011

BACKFLOW PREVENTER (BFP): \_\_\_\_\_

BUSINESS NAME: \_\_\_\_\_

TYPE: (circle) RP or DC \_\_\_\_\_

SERVICE ADDRESS: \_\_\_\_\_


MAKE: \_\_\_\_\_

TYPE OF BUSINESS: \_\_\_\_\_

MODEL: \_\_\_\_\_

SIZE: \_\_\_\_\_

**D** THIS DETAIL IS FOR RESIDENTIAL WATER SERVICES WHERE BACKFLOW PREVENTION IS REQUIRED AND A CONTINUOUS ROLL OF COPPER FROM CURB-BOX TO INSIDE WALL OF THE HOUSE OR STRUCTURE CAN NOT BE INSTALLED.

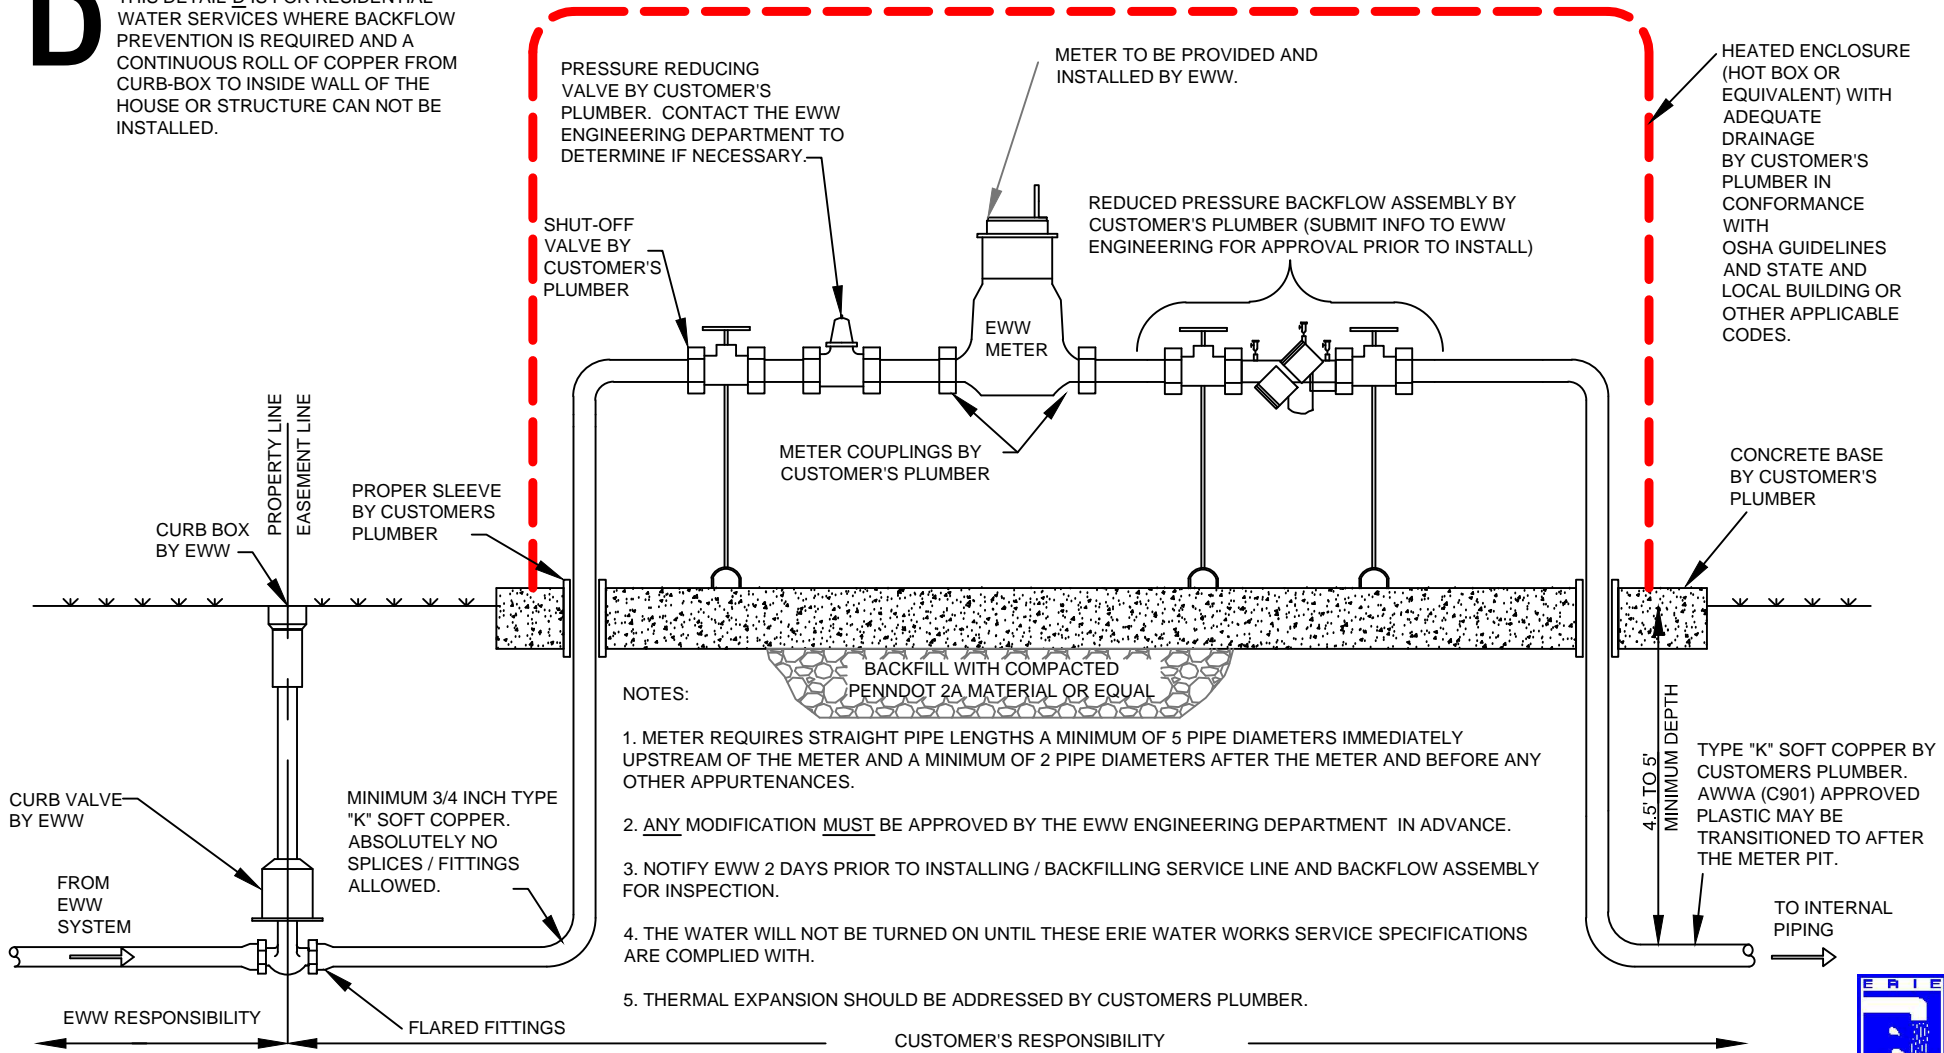

- NOTES:
1. METER REQUIRES STRAIGHT PIPE LENGTHS A MINIMUM OF 5 PIPE DIAMETERS IMMEDIATELY UPSTREAM OF THE METER AND A MINIMUM OF 2 PIPE DIAMETERS AFTER THE METER AND BEFORE ANY OTHER APPURTENANCES.
  2. ANY MODIFICATION MUST BE APPROVED BY THE EWW ENGINEERING DEPARTMENT IN ADVANCE.
  3. NOTIFY EWW 2 DAYS PRIOR TO INSTALLING / BACKFILLING SERVICE LINE AND BACKFLOW ASSEMBLY FOR INSPECTION.
  4. THE WATER WILL NOT BE TURNED ON UNTIL THESE ERIE WATER WORKS SERVICE SPECIFICATIONS ARE COMPLIED WITH.
  5. THERMAL EXPANSION SHOULD BE ADDRESSED BY CUSTOMERS PLUMBER.

DRAWN BY: PH	APPROVED BY: CP
DATE: OCT 2010	NOT TO SCALE

## RESIDENTIAL SERVICE (ENCLOSURE) BFP

ERIE WATER WORKS  
 240 West 12th Street  
 Erie, PA 16501

