

PLEASE COMPLETE AND RETURN TO ERIE WATER WORKS ENGINEERING DEPARTMENT  
 240 WEST 12TH STREET, ERIE, PA 16501  
 PH: (814) 870-8000 EXT 205, FAX: (814) 870-8011

**BACKFLOW PREVENTER (BFP):** \_\_\_\_\_

**TYPE:** (circle) RP or DC \_\_\_\_\_

**MAKE:** \_\_\_\_\_

**MODEL:** \_\_\_\_\_

**SIZE:** \_\_\_\_\_

**BUSINESS NAME:** \_\_\_\_\_


**SERVICE ADDRESS:** \_\_\_\_\_

**TYPE OF BUSINESS:** \_\_\_\_\_

**E** THIS DETAIL IS FOR A NON-RESIDENTIAL WATER SERVICES REQUIRING BACKFLOW PREVENTION AND A CONTINUOUS ROLL OF COPPER FROM CURB-BOX TO INSIDE WALL OF THE STRUCTURE CAN BE INSTALLED. ABSOLUTELY NO FITTINGS / SPLICES ARE ALLOWED. A HOT-BOX OR EQUIVALENT WILL BE NECESSARY IF THE SERVICE REQUIRES MORE THAN ONE CONTINUOUS ROLL OF COPPER.

**NOTES:**

1. METER REQUIRES STRAIGHT PIPE LENGTHS A MINIMUM OF 5 PIPE DIAMETERS IMMEDIATELY UPSTREAM OF THE METER AND A MINIMUM OF 2 PIPE DIAMETERS AFTER THE METER AND BEFORE ANY OTHER APPURTENANCES.
2. ANY MODIFICATION MUST BE APPROVED BY THE EWW ENGINEERING DEPARTMENT IN ADVANCE.
3. NOTIFY EWW 2 DAYS PRIOR TO INSTALLING / BACKFILLING SERVICE LINE AND BACKFLOW ASSEMBLY FOR INSPECTION.
4. THE WATER WILL NOT BE TURNED ON UNTIL THESE ERIE WATER WORKS SERVICE SPECIFICATIONS ARE COMPLIED WITH.
5. THERMAL EXPANSION SHOULD BE ADDRESSED BY CUSTOMERS PLUMBER.

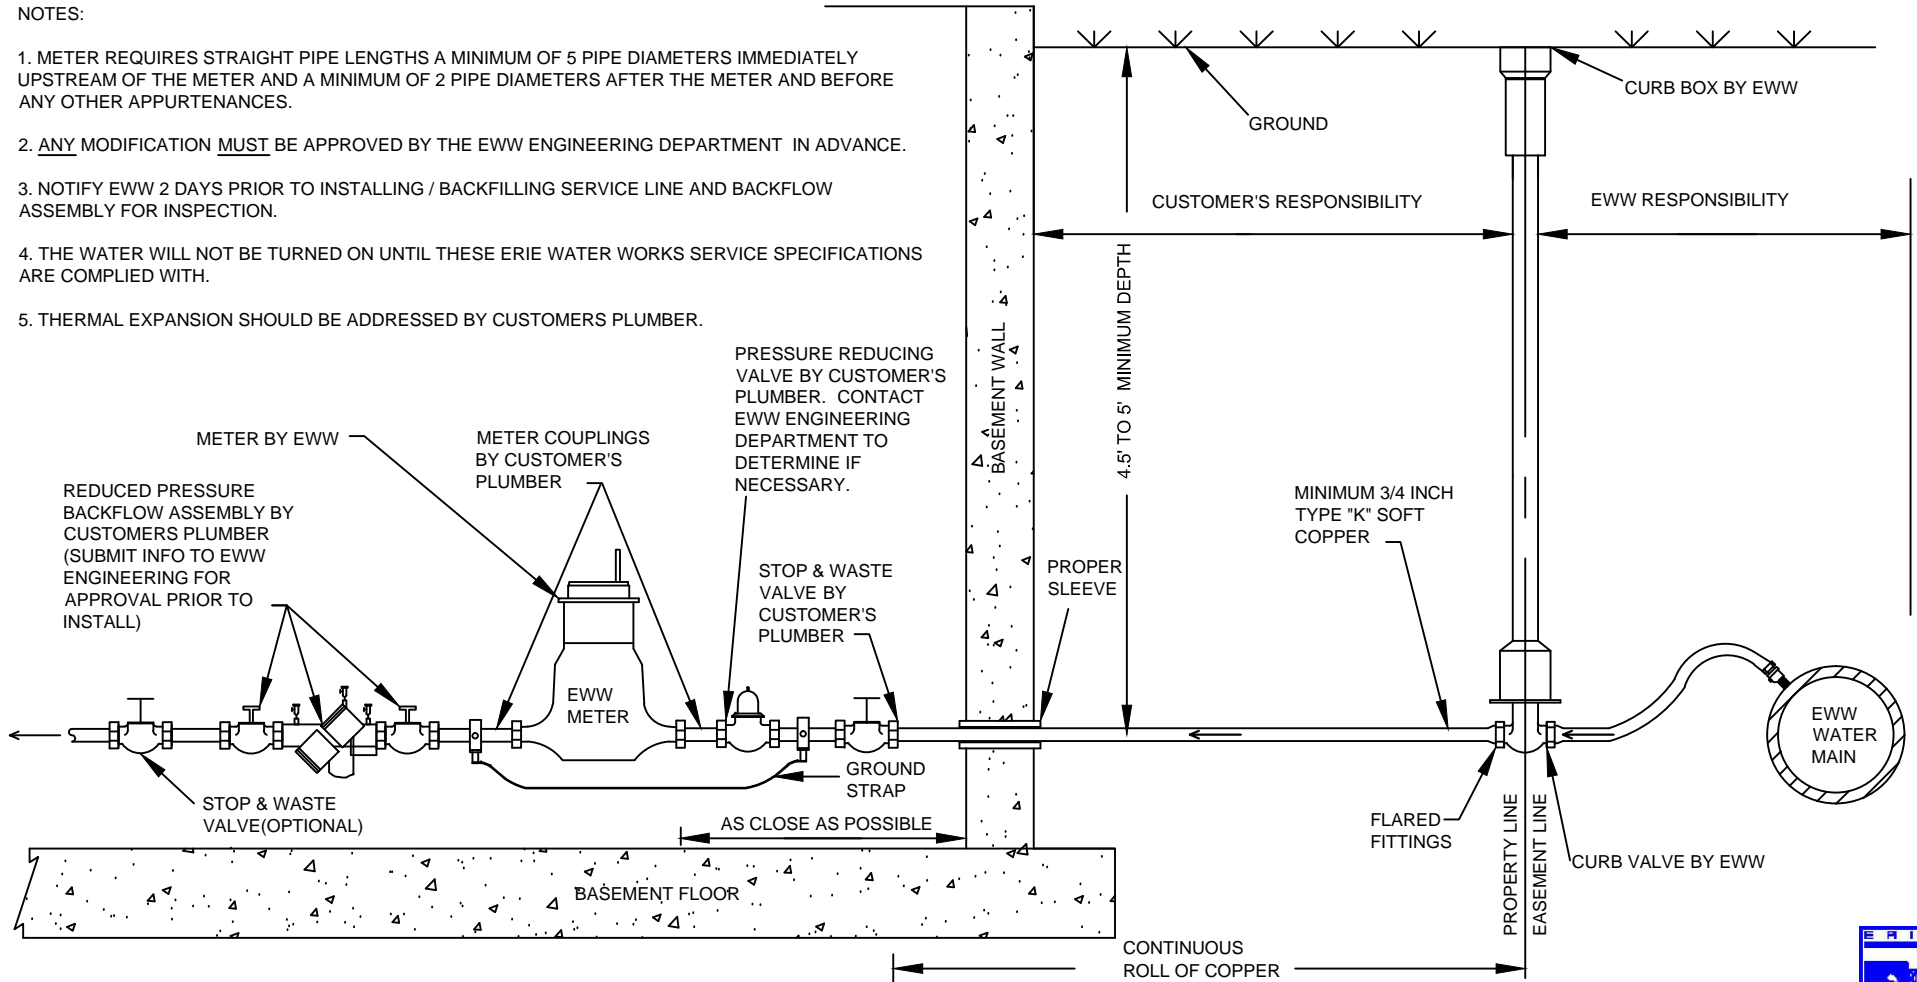

|                |                 |
|----------------|-----------------|
| DRAWN BY: PH   | APPROVED BY: CP |
| DATE: OCT 2010 | NOT TO SCALE    |

**NON-RESIDENTIAL SERVICE (CONTINUOUS ROLL OF COPPER) BFP**

**ERIE WATER WORKS**  
 240 West 12th Street  
 Erie, PA 16501

