


REDUCED PRESSURE ZONE (RPZ) BACK FLOW PREVENTER IS REQUIRED. APPLY FOR A PERMIT 2 DAYS IN ADVANCE AT ERIE WATER WORKS 340 WEST BAYFRONT PARKWAY ERIE, PA 16507. 2 INCH BACK FLOW PREVENTER IS THE MAXIMUM AVAILABLE THROUGH EWW. IF LARGER UNIT IS NEEDED TO OBTAIN SCOURING VELOCITIES (PER AWWA C-651 STANDARD, LATEST REVISION), CONTRACTOR SHALL PROVIDE.

NOTES:

- 1. TAPS MADE TO THE POLYETHYLENE ENCASED PIPE MUST BE MADE IN STRICT CONFORMANCE TO THE MANUFACTURERS INSTALLATION REQUIREMENTS. ENCASEMENT INTEGRITY MUST NOT BE BREACHED.
- 2. ANY MODIFICATION MUST BE APPROVED BY THE EWW ENGINEERING DEPARTMENT IN ADVANCE.

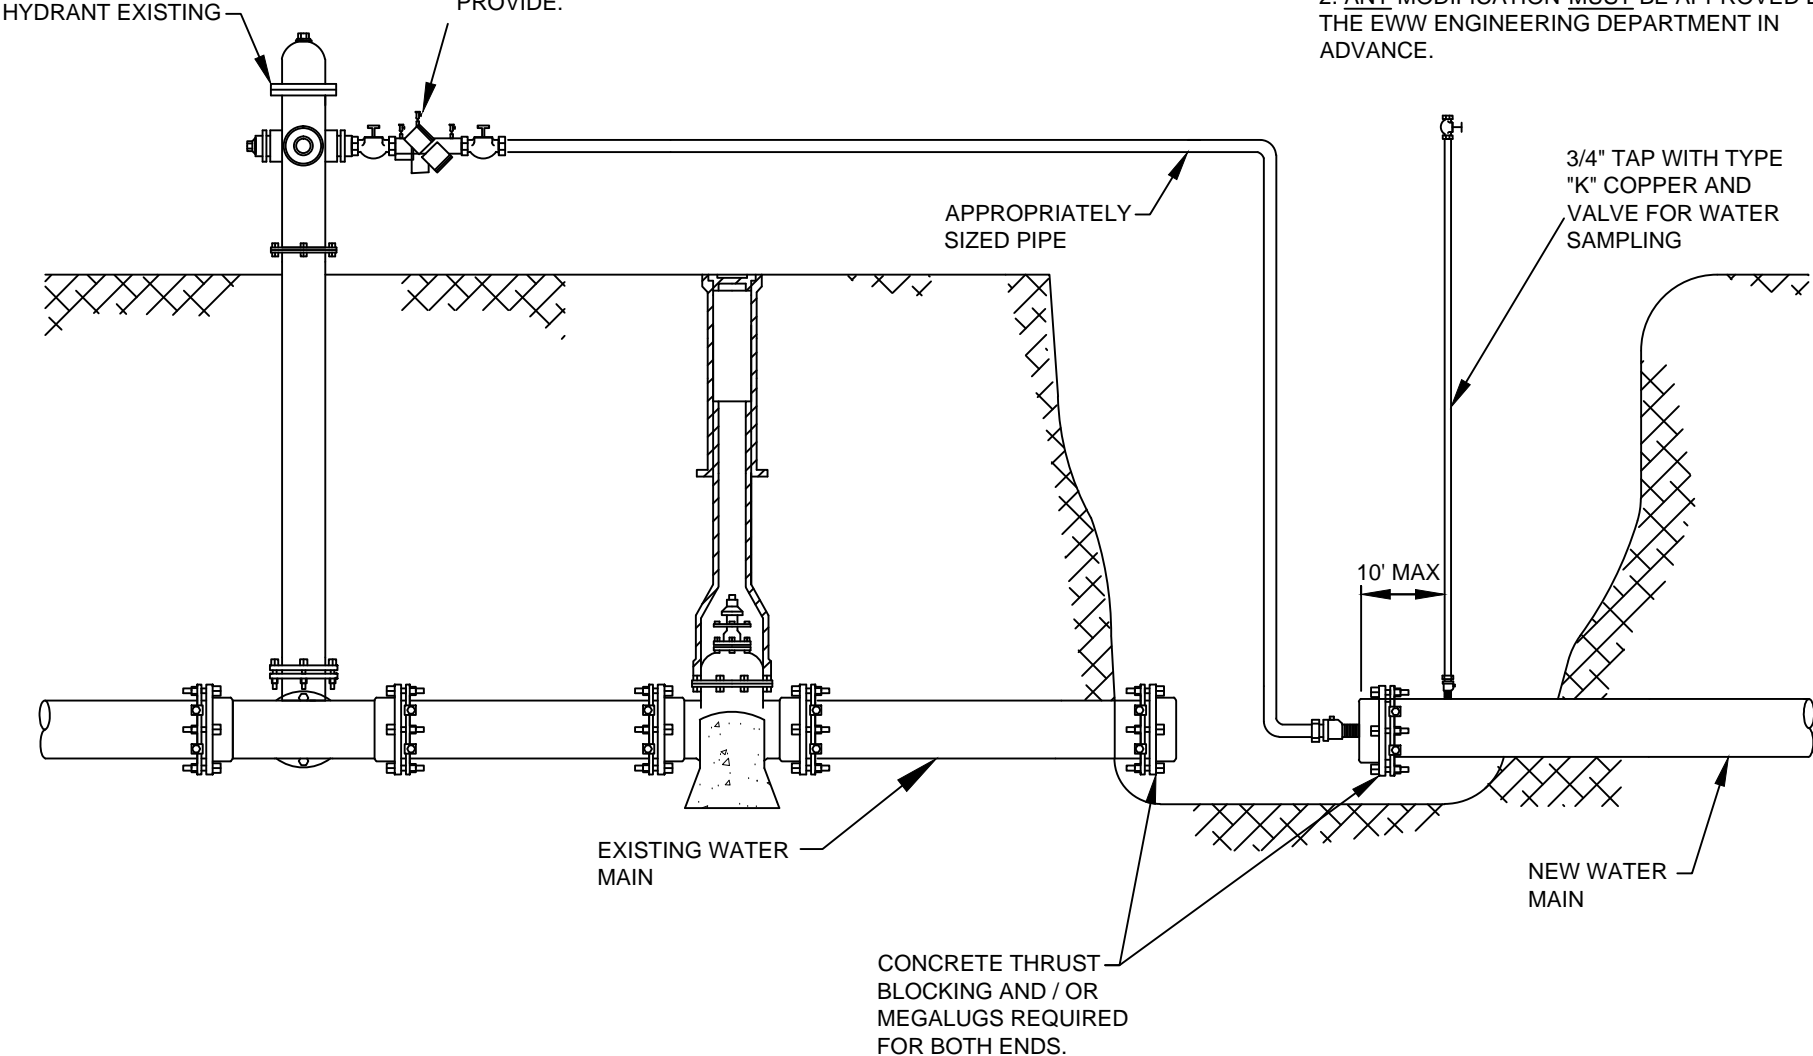

TEMPORARY FILL CONNECTION (HYDRANT)

DRAWN BY: PH	APPROVED BY: CP
DATE: OCT 2010	NOT TO SCALE

ERIE WATER WORKS
240 West 12th Street
Erie, PA 16501

