


DETAIL TO BE USED IF NO HYDRANT IS PRESENT

NOTES:

1. TAPS MADE TO THE POLYETHYLENE ENCASED PIPE MUST BE MADE IN STRICT CONFORMANCE TO THE MANUFACTURERS INSTALLATION REQUIREMENTS. ENCASEMENT INTEGRITY MUST NOT BE BREACHED.

2. ANY MODIFICATION MUST BE APPROVED BY THE EWW ENGINEERING DEPARTMENT IN ADVANCE.

REDUCED PRESSURE ZONE (RPZ) BACK FLOW PREVENTER IS REQUIRED. APPLY FOR A PERMIT 2 DAYS IN ADVANCE AT ERIE WATER WORKS 340 WEST BAYFRONT PARKWAY ERIE, PA 16507. 2 INCH BACK FLOW PREVENTER IS THE MAXIMUM AVAILABLE THROUGH EWW. IF LARGER UNIT IS NEEDED TO OBTAIN SCOURING VELOCITIES (PER AWWA C-651 STANDARD, LATEST REVISION), CONTRACTOR SHALL PROVIDE.

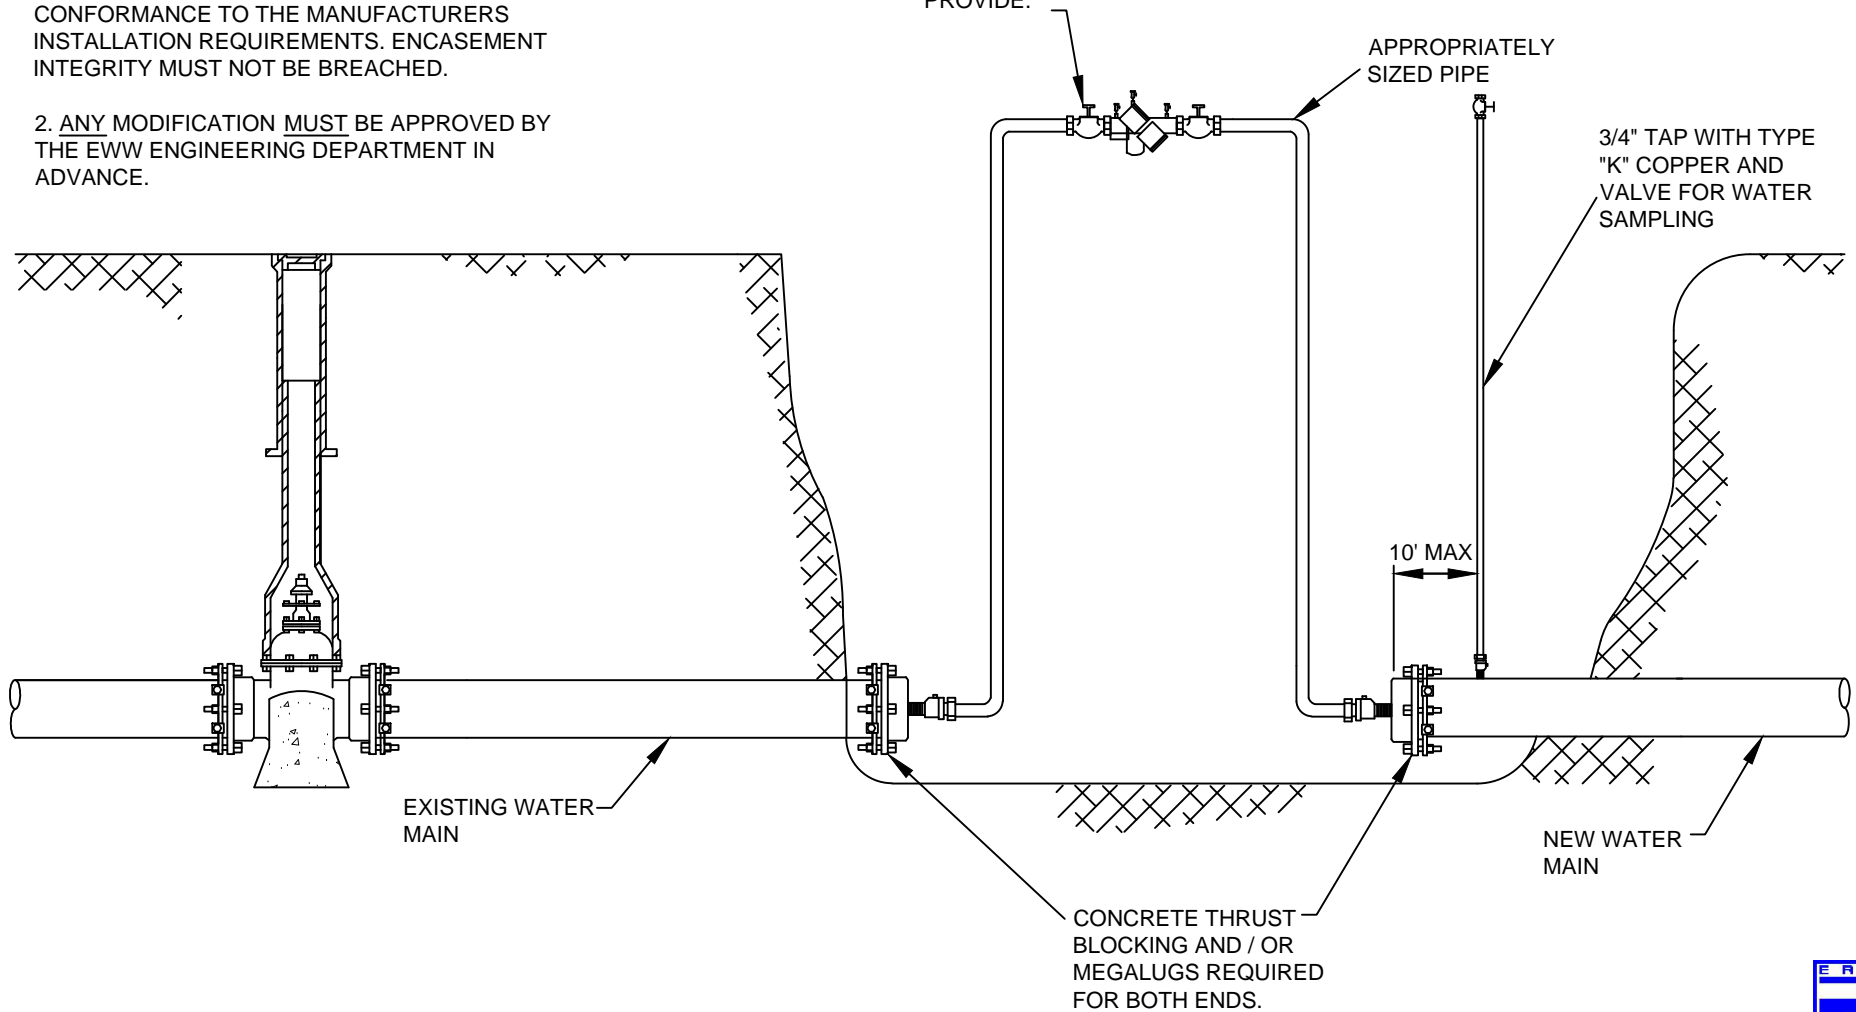

DRAWN BY: PH	APPROVED BY: CP
DATE: OCT 2010	NOT TO SCALE

TEMPORARY FILL CONNECTION (NO HYDRANT)

ERIE WATER WORKS
240 West 12th Street
Erie, PA 16501

